

Southern Iraq gas station conversation to integrated solar combined cycle

Abass Ahmed. Z.¹, Pavlyuchenko.D.A.²

¹Novosibirsk State Technical University, Industrial Power Supply Systems Novosibirsk, 630073, Russia, Ph.D. student.

²Novosibirsk State Technical University, Industrial Power Supply Systems, Ph.D., Associate Professor, Head of Department, Novosibirsk, 630073, Russia

Abstract. Iraq has a big shortage in the electrical system and this is because of repeated wars that have destroyed the country's economy and infrastructure. In order to improve the situation and progress of the country we see that the exploitation of huge and neglected land, where Iraq has a very featured site can make it a factory for the production of electric power through the exploitation of the vast areas as fields of cells and solar plants to produce electricity. Iraq is characterized by the number of sunny hours during the year and estimated more than 3300 hours. Also, the solar radiation in Iraq, which exceeds 2000 kWh/m². Where the production of electricity enough to meet the needs of Iraq and neighboring countries. In this paper we will discuss the development of gas station in southern Iraq by taking advantage of the sun's rays falling and recycling of combustion products from the gas station. The plant consists of 200MW conventional gas turbine plant and two steam turbines of 75MW and 65MW powered by the solar field and gas turbine exhaust. With high insolation during the summer month of June the plant can achieve up to 25% of solar fraction with Integrated Solar Combined Cycle (ISCC) plant.

1 Introduction

The world demand for energy have increased with the increasing population and resources like fossil fuels (coal, natural gas, oil, etc.) are not reliable as it was in the previous century, as unsteadiness in oil prices can be very damaging especially to countries and industries that consider fossil fuel as their base. Renewable energy technologies have become main stream during the last three decades; treaties set by decision makers were signed to establish renewable energy as a worldwide solution to problems such as energy shortage and worldwide warming. Solar power is one of the leading renewable energy resources due to its low price for people and it emitting zero emissions and noise. Two major technologies used under the solar power umbrella are the solar cell 'Photovoltaic' and the solar thermal collector. More than 80% of the 20,132TWh world total electricity production and consumption in 2009 is from fossil fuel [1,2].

With the reality of the effect of global climate change, measures need to be taken to limit pollution (CO₂, CH₄ and NO_x) emission gases coming from the fossil fuel fired power plants. Fossil fuel is limited which require the need to look inward for a sustainable and environmental friendly means of generating electricity. With advances in solar technology in the last two decades, production of electricity from solar has renewed the interest in solar thermal power generation. However, due to high amount of heat lost during start up and shut

down, high cost of storing heat energy for off sun period as well as high technical and economical risk, its application has been limited and has given rise to the introduction of the solar hybrid system. Integrated Solar Combined Cycle (ISCC) proposed a means of integrating a parabolic trough solar field with modern combined cycle power plants with the aim of improving system cost and efficiency.

Several works have been carried out to look at the potential and viability of ISCC plant at different locations. The ISCC can either be operated as a direct steam generation (DSG) or using separate fluid such as thermal oil or salt as the heat transfer fluid (HTF). The output power of an ISCCS-DSG power plant to be higher than ISCCS-HTF plant which resulted in less CO₂ emissions, and save about 46 million \$ in fuel consumption through the 30 years' operating period and concluded that ISCCS-DSG is the best option for using solar energy, especially in arid countries rich in natural gas like Iraq. Iraq is blessed with abundance solar energy with high solar radiation intensity estimated at 2000 kWh/m² and rich in natural gas [3].

The cycle that has been adopted for the present study is presented in Fig (1). The plant layout is a gas turbine layout of 200MW capacity located in Basra city, and we adding two steam turbines of 75 MW (high pressure) and 65MW (low pressure), a re-heater and an economizer. Provision for auxiliary energy is incorporated to be used to compliment the solar field or during the night. The

theking.amir@mail.ru

analyses are given in literature [13]. Some selected equations are: the useful energy gain from the parabolic trough solar concentrator is given by [14]. A simplified mathematical model of typical ISCC system is developed in this paper. Mass and energy conservation laws were applied to the gas and steam turbine units, heat recovery and solar steam generators using Engineering Equations Solver software (EES) to evaluate the performance of ISCC system.

$$Q_u = F_R * (A_a * DNI * \cos(\theta) * \eta_{optical} * K_{\theta} - A_r * U_{abs} * (T_r - T_a)) \quad (1)$$

$$K_{\theta} = 1 - 6.74e(-5) * \theta^2 + 1.64e(-6) * \theta^3 - 2.51e(-8) * \theta^4 \quad (2)$$

$$DNI = I * \cos(\theta_z) \quad (3)$$

$$W_{ISCC} = W_{gt} + W_{T1} + W_{T2} \quad (4)$$

$$\eta_{ISCC} = W_{ISCC} / E_{in} \quad (5)$$

$$F_{solar} = W_{solar} / W_{ISCC} \quad (6)$$

Basra has a good climatic cycles which can be represented by the average day of the months of March, June, September and December. Direct normal insolation (DNI) of the location given in Fig (2) was observed to be highest in June with more than 800W/m² at noon local time and least in December with about 400W/m² [8,15].

Table 1. Solar radiation falling at region between Basra and Nassrya at 2017, kWh/m²[9,15].

Lat	Lon	Dec	Jan	Feb	
30.25	46.25	4.29	3.54	4.42	
30.25	47.25	4.21	3.44	4.12	
30.25	48.25	4.14	3.27	4.16	
31.25	46.75	4.03	3.18	4.24	
31.25	47.25	4.01	3.13	4.13	
31.25	48.25	4.09	3.14	4.14	
Lat	Lon	Jun	Jul	Aug	Ann
30.25	46.25	8.97	7.53	7.07	5.57
30.25	47.25	7.91	7.37	7	5.47
30.25	48.25	8.87	7.28	6.9	5.41
31.25	46.75	7.87	7.31	6.94	5.35
31.25	47.25	7.82	7.2	6.87	5.33
31.25	48.25	8.94	7.27	6.63	5.37

The expected solar field output is given in Fig (3). The solar field output in June can be observed to be more than of December. This can be attributed to low DNI in the later month.

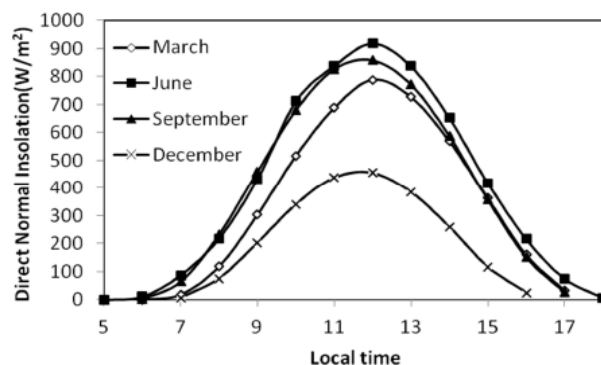


Fig. 2. Direct normal insolation

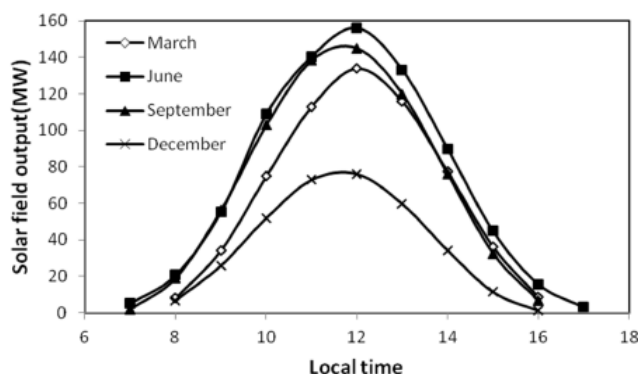


Fig. 3. Solar field output

The result of the integral energy analysis of the proposed plants given in Fig (4) shows that the overall power output is nearly constant for all months during the early and later part of the day.

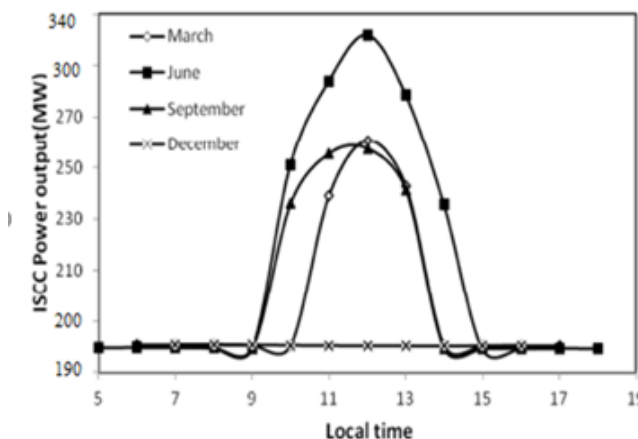


Fig. 4. ISCC power output

This is due to the low solar intensity and collection efficiency, this factor is more dominant in December because of low intensity of solar energy DNI. The ISCC can achieve up to 330MW in June resulting in the combined cycle improvement from the base case efficiency of about 38% to 55% as shown in Fig (5).

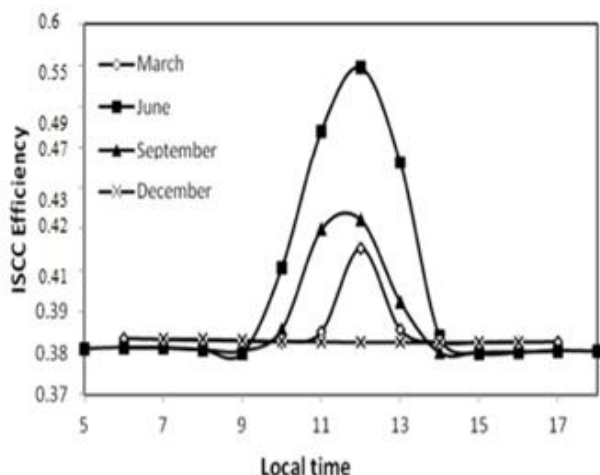


Fig.5. ISCC efficiency

This improvement is not only due to energy from the solar field but also the energy extracted from the gas turbine exhaust. The percentage of power produced due to solar field output referred to as the solar fraction is summarized in Fig (3). It can be observed that solar field output for December is very low. Hence, its solar fraction is not represented in Fig (3). At noon in the month of June, with more than 800W/m² DNI, the solar fraction can be nearly 25% which is promising Fig (6).

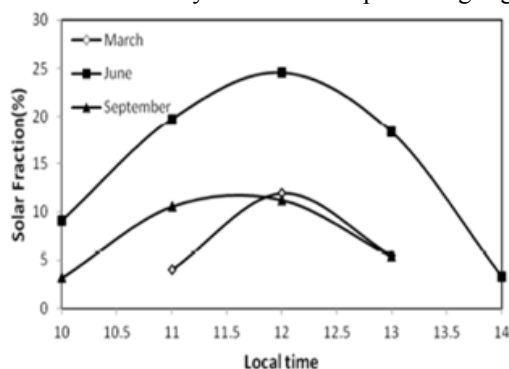


Fig. 6. solar fraction

Figure (7) shows the power comparison that may be typical of the ISCC power plant, while it can be observed that there is availability of power from the solar field both in the earlier and later part of the day, there is no power output from the steam turbines, this can be attributed to the low intensity of solar energy. This energy can however be exploited by the use of auxiliary energy in order to obtain maximum benefit from the solar field and increase the overall efficiency. The effect of solar collector multiple when increasing the number of collectors from 450 to 600 increases the solar fraction from 24% to about 40% and this increase in the solar fraction and efficiency is due to availability of additional energy from the solar field.

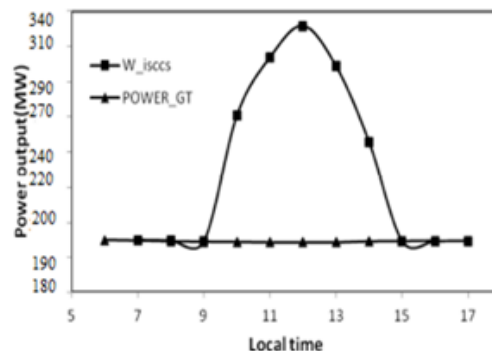


Fig. 7. power comparison

6 Conclusions

Iraq has excellent solar radiation, ranging from 1,800 to 2,390 kWh/m²/yr of direct normal irradiation, and much of the flat Iraqi landscape is appropriate for an ISCC plant. The benefits of implementing ISCC plants have also been investigated to support the decision-makers in selecting good future needs. Results showed the following:

- the output power is a strong function of solar heat input at different ambient temperatures, it could reach up to 330MW at solar heat input 880kWh/m²;
- Al Basra ISCC power plant efficiency could reach to 55% which is 20-80% higher than current conventional power plants;
- the kind of fuel, ambient temperature, turbine inlet temperature, solar heat input, capacity factor, and solar fraction are the main factors affecting the performance of the plant;
- the main benefits of ISCC power plant are fuel saving, the reduction of electricity demand at the peak period as well as the reduction of carbon emissions. The expected annual fuel saving in terms of barrel of oil equivalent is around 115350 boe/year, while the carbon emissions reduction will be around 170672 ton/year;
- reconstruction the current conventional plants (gas turbine and steam turbine) to ISCC power plants will reduce millions tons of carbon emissions and save millions barrels of oil equivalent annually, this will save millions \$ over the lifespan of the plants.

References

1. IEA. Electricity/Heat in World 2009 (cited 2013 March 12) URL: http://www.iea.org/stats/electricitydata.asp?COUNTRY_CODE=29.M.
2. Abass Ahmed. Z. , Pavlyuchenko.D.A, Eliminate the electricity shortage in Iraq by using PV/T panels and hybrid solar stations. IX All-Russian Scientific and Practical Conference "Scientific Initiative of foreign students and graduate students of Russian universities" (April 24 - 26, 2019), Tomsk.
3. A. A. Al-Waely, S. D. Salman, W. K. Abdol-Reza, M. T. Chaichan, H. A. Kazem and H. S. Al-Jibori, "Evaluation of the spatial distribution of shared electrical generators and their environmental effects at Al-Sader

City-Baghdad-Iraq," International Journal of Engineering & Technology IJET-IJENS, vol. **14**, No. 2, pp. 16-23, 2014.

4. Ministry of electricity Iraq URL:

<https://www.moelc.gov.iq/> .

5. Al-Qamar company URL:

www.qamarenergy.com .

6. Wikipedia, the free encyclopedia, URL:
<https://en.wikipedia.org/wiki/Iraq> .

7. Library of Congress, 1988. "Iraq—A country study (last accessed 26 February 2002) URL:

<http://www.loc.gov> .

8. Jane Burgermeister, March 3, 2009, Iraq Looks to Solar Energy To Help Rebuild its Economy URL:

<http://www.renewableenergyworld.com/rea/news/article/2009/03/iraq-looks-to-solar-energy-to-help-rebuild-itseconomy> .

9. NASA Prediction Of Worldwide Energy Resources URL:

<https://power.larc.nasa.gov/> .

10. M.A. Darwish, On the use of integrated solar-combined cycle with desalting units in Qatar, J. Desalination Water Treat 53 (2015) 855e875.

11. Nezammahalleh, H., F. Farhadi, and M. Tanhaemami, Conceptual design and techno-economic assessment of integrated solar combined cycle system with DSG technology. Solar energy, (2010). 84(9): p. 1696-1705.

12. J. Zachary, in: Ashok D. Rao (Ed.), Integrated Solar Combined Cycle (ISCC) Systems (Ch.10), Combined Cycle Systems for Near-zero Emission Power Generation, Book, Woodhead Publishing Series in Energy,(2012). Number 32.

13. Baghernejad, A. and M. Yaghoubi, Exergoeconomic analysis and optimization of an Integrated Solar Combined Cycle System (ISCCS) using genetic algorithm. Energy Conversion and Management, (2011). 52(5): p. 2193-2203.

14. Dersch, J., et al., Trough integration into power plants-a study on the performance and economy of integrated solar combined cycle systems. Energy, (2004). 29(5): p. 947-959.

15. Abass Ahmed. Z. Pavlyuchenko.D.A, the exploitation of western and southern deserts in Iraq for the production of solar energy, International Journal of Electrical and Computer Engineering (IJECE), Vol **9**, No 6. (2019).