

Heat transfer in fluidized and fixed beds of adsorption chillers

Jaroslaw Krzywanski^{1,*}, Karolina Grabowska¹, Marcin Sosnowski¹, Anna Zylka¹, Anna Kulakowska¹, Tomasz Czakiert², Karol Sztekler³, Marta Wesolowska³ and Wojciech Nowak³

¹Jan Dlugosz University in Czestochowa, Faculty of Science and Technology A. Krajowej 13/15, 42-200 Czestochowa, Poland

²Czestochowa University of Technology, Institute of Advanced Energy Technologies, Dabrowskiego 73, 42-200 Czestochowa, Poland

³AGH University of Science and Technology, Faculty of Energy and Fuels, A. Mickiewicza 30, 30-059 Cracow, Poland

Abstract. An innovative idea, shown in the paper constitutes in the use of the fluidized bed of sorbent, instead of the conventional, fixed-bed, commonly used in the adsorption chillers. Bed-to-wall heat transfer coefficients for fixed and fluidized beds of adsorbent are determined. Sorbent particles diameters and velocities of fluidizing gas are discussed in the study. The calculations confirmed, that the bed-to-wall heat transfer coefficient in the fluidized bed of adsorbent is much higher than that in a conventional bed..

Nomenclature

c constant representing the mixing of gas in the vicinity of wall, -
C specific heat capacity, J kg⁻¹ K⁻¹
U heat transfer coefficient, W m⁻² K⁻¹

Subscripts

b bed
bub bubble
e effective
fl fluidized bed
fx fixed bed
g gas
mf at minimum fluidizing conditions
s solid
w wall region

Superscripts

0 for stagnant gas conditions

Greek Symbols

δ fraction of bed in bubbles, -
 ε void fraction in a bed at minimum fluidizing conditions, -
 λ thermal conductivity, W m⁻¹ K⁻¹
 ρ density, kg m⁻³
 V_b velocity of a bubble rising through a bed, m s⁻¹
 V_0 superficial gas velocity, m s⁻¹

Acronyms

AC Adsorption Chiller

1 Introduction

The main disadvantages of conventional fixed-bed adsorption chillers are low coefficients of performance (COP) [1–4].

One of the well-known method, allowing to improve the heat transfer coefficient between the bed and the immersed heating surface, widely used in energy boilers, is using fluidized bed [5–15]. A similar idea appears concerning to adsorption chillers [1,2,16]. Wang et al. [17] proposed to use a fluidized – bed adsorber/desorber for the adsorption refrigeration system. The authors pointed out that the fluidized adsorbent can enhance the heat and mass transfer, leading to the increase the specific cooling power.

A periodic operating silica gel fluidized bed unit to adsorb/desorb moisture in air-conditioning systems was proposed by Chen et al. [18] The authors reported possibility to increase the adsorption and desorption processes in that the fluidized bed system compared with the unit equipped with a packed bed.

An inclined-fluidized bed in the adsorption and desorption operations was carried out by Hamed [19]. Rogala et al. considered air-fluidized systems developing a method for the prediction of silica gel-water adsorption [20].

The objective of the paper is to study the wall-to-bed heat transfer coefficient in fluidized and fixed beds of adsorption chillers.

* Corresponding author: j.krzywanski@ujd.edu.pl

2 Material and methods

The re-heat two-stage adsorption chiller (AC) was considered in the study. This AC comprises of four adsorbent beds, evaporator, and condenser [21,22]. Silica gel and water stand for a working pair. The scheme of the adsorption chiller is shown in Fig. 1.

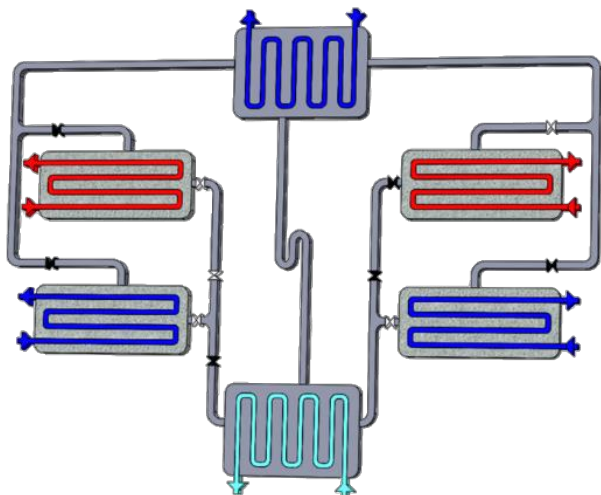


Fig. 1. The re-heat two-stage adsorption chiller.

The operational parameters of the chiller in standard operating conditions are as follows: flow rates of hot and cooling water in the adsorber: 0.5 kg s^{-1} , temperatures of cooling and chilled water: $30 \text{ }^\circ\text{C}$ and $14 \text{ }^\circ\text{C}$, respectively. Further details of the chiller can be found elsewhere [21,22]. Three different materials are considered during the study: silica-gel, zeolite, and carbon nanotubes. According to Kunii and Levenspiel (1991) a heat transfer coefficient for the wall region with flowing gas and the fixed bed can be described as follows:

$$U_{fx} = U_w^0 + c_w(C_g \rho_g v_0) = \frac{2\lambda_{ew}^0}{d_p} + c_w(C_g \rho_g v_0) \quad (1)$$

where: $c_w = 0.05$.

The heat transfer coefficient between the heat exchanger surface and a fluidized bed can be written, as follows [23]:

$$U_{fl} = \frac{1 - \delta}{\frac{1}{U_{fx}} + 1.13 \left[\lambda_e^0 \rho_s (1 - \varepsilon_{mf}) C_s n_w / (1 - \delta_w) \right]^{0.5}} \quad (2)$$

where:

$$\delta = \frac{v_0 - v_{mf}}{v_b - v_{mf}},$$

$$v_b = 0.711(gd_{bub})^{0.5}$$

Taking into account the above equations, we can assess heat transfer coefficients in the wall region of fixed and fluidized bed with flowing gas, i.e. water vapor as an adsorbate, U_{fx} , and U_{fl} , respectively.

3 Results and discussion

The influence of superficial gas velocity on heat transfer for fixed and fluidized bed of silica gel, zeolite, and carbon nanotubes are given in Table 1.

The obtained results reveal, that the bed-to-wall heat transfer coefficient during fluidization is much higher than the one for a fixed bed.

The influence of superficial gas velocity on bed-to-wall heat transfer coefficient for different shares of carbon nanotubes in the bed of silica gel particles is given in Table 2.

Similar calculations are performed for a mixture of zeolite and carbon nanotubes. The obtained data can be found in Table 3.

As it can be seen from the tables, even a small amount of carbon nanoparticles significantly improve the bed-to-wall heat transfer coefficient for both and fluidized bed.

4 Conclusions

Fixed and bubbling fluidized bed conditions are considered in the paper. The model allows conducting a numerical study and describes the behaviour of heat transfer in the fixed and fluidized bed for a wide range of operational sceneries.

The proposed design concept allows significantly increase the heat transfer coefficient between adsorption bed and the surface of a heat exchanger as well as the bed conductance.

The use of a fluidized bed will help improve the coefficient of performance and cooling capacity of the chiller.

Scientific work was performed within the project No. 2018/29/B/ST8/00442, "Research on sorption processes intensification methods in modified construction of adsorbent beds" supported by National Science Center, Poland. The support is gratefully acknowledged.

Table 1. Heat transfer coefficients for basic solids.

Carbon nanotubes						
V_0	d = 50 μm		d = 100 μm		d = 150 μm	
	U_{fx}	U_{fl}	U_{fx}	U_{fl}	U_{fx}	U_{fl}
m s^{-1}	$\text{W m}^{-2} \text{K}^{-1}$					
0.030	126.36	478.07	63.19	463.35	42.14	453.93
0.100	126.45	554.02	63.28	526.12	42.22	509.43
0.500	126.93	372.89	63.77	297.52	42.71	262.65

Silica gel						
V_0	d = 50 μm		d = 100 μm		d = 150 μm	
	U_{fx}	U_{fl}	U_{fx}	U_{fl}	U_{fx}	U_{fl}
m s^{-1}	$\text{W m}^{-2} \text{K}^{-1}$					
0.030	21.81	341.44	10.92	305.59	7.29	280.89
0.100	21.89	377.06	11.01	327.29	7.38	294.37
0.500	22.38	175.31	11.49	128.12	7.87	103.99

Zeolite						
V_0	d = 50 μm		d = 100 μm		d = 150 μm	
	U_{fx}	U_{fl}	U_{fx}	U_{fl}	U_{fx}	U_{fl}
m s^{-1}	$\text{W m}^{-2} \text{K}^{-1}$					
0.030	13.69	280.18	6.87	243.09	4.59	219.05
0.100	13.78	305.42	6.95	255.86	4.68	225.17
0.500	14.26	131.53	7.44	92.35	5.16	73.53

Table 2. Heat transfer coefficients for silica gel and carbon nanotubes particles.

Silica gel (90%) wt. and carbon nanotubes 10% (wt.)						
V_0	d = 50 μm		d = 100 μm		d = 150 μm	
	U_{fx}	U_{fl}	U_{fx}	U_{fl}	U_{fx}	U_{fl}
m s^{-1}	$\text{W m}^{-2} \text{K}^{-1}$					
0.030	55.41	580.99	27.72	539.33	18.49	509.95
0.100	55.49	651.70	27.80	590.11	18.58	547.99
0.500	55.98	336.42	28.29	258.72	19.06	217.34

Silica gel (80%) wt. and carbon nanotubes 20% (wt.)						
V_0	d = 50 μm		d = 100 μm		d = 150 μm	
	U_{fx}	U_{fl}	U_{fx}	U_{fl}	U_{fx}	U_{fl}
m s^{-1}	$\text{W m}^{-2} \text{K}^{-1}$					
0.030	60.90	617.72	30.47	574.47	20.32	543.59
0.100	60.99	693.68	30.55	629.50	20.41	585.16
0.500	61.47	361.06	31.04	278.42	20.89	234.18

Table 3. Heat transfer coefficients for zeolite and carbon nanotubes particles.

Zeolite (90%) wt. and carbon nanotubes 10% (wt.)						
V_0	d = 50 μm		d = 100 μm		d = 150 μm	
	U_{fx}	U_{fl}	U_{fx}	U_{fl}	U_{fx}	U_{fl}
m s^{-1}	$\text{W m}^{-2} \text{K}^{-1}$					
0.030	55.41	619.21	27.72	573.01	18.49	541.49
0.100	55.49	693.03	27.80	625.14	18.58	579.94
0.500	55.98	352.03	28.29	269.40	19.06	226.03

Zeolite (80%) wt. and carbon nanotubes 20% (wt.)						
V_0	d = 50 μm		d = 100 μm		d = 150 μm	
	U_{fx}	U_{fl}	U_{fx}	U_{fl}	U_{fx}	U_{fl}
m s^{-1}	$\text{W m}^{-2} \text{K}^{-1}$					
0.030	60.90	651.35	30.47	604.17	20.32	571.34
0.100	60.99	730.11	30.55	660.48	20.41	613.35
0.500	61.47	374.99	31.04	288.01	20.89	241.94

23. D. Kunii and O. Levenspiel, *Fluidization Engineering* (Elsevier, 2013)

References

1. J. Krzywanski, K. Grabowska, M. Sosnowski, A. Żyłka, K. Sztekler, W. Kalawa, T. Wójcik, and W. Nowak, *MATEC Web of Conferences* **240**, 05014 (2018)
2. J. Krzywanski, K. Grabowska, M. Sosnowski, A. Żyłka, K. Sztekler, W. Kalawa, T. Wójcik, and W. Nowak, *Thermal Science* **23**, 1053 (2019)
3. K. Grabowska, M. Sosnowski, J. Krzywanski, K. Sztekler, W. Kalawa, A. Żyłka, and W. Nowak, *Journal of Thermal Science* **27**, 421 (2018)
4. K. Grabowska, M. Sosnowski, J. Krzywanski, K. Sztekler, W. Kalawa, A. Żyłka, and W. Nowak, *MATEC Web Conf.* **240**, 01010 (2018)
5. M. L. de Souza-Santos, *Energy* **120**, 959 (2017)
6. J. Krzywanski, A. Żyłka, T. Czakiert, K. Kulicki, S. Jankowska, and W. Nowak, *Powder Technology* **316**, 592 (2017)
7. J. Werther, *Powder Technology* **102**, 15 (1999)
8. J. Krzywanski, M. Wesolowska, A. Blaszczyk, A. Majchrzak, M. Komorowski, and W. Nowak, *Procedia Engineering* **157**, 66 (2016)
9. A. Blaszczyk and J. Krzywański, *Archives of Thermodynamics* **38**, 91 (2017)
10. J. Krzywanski, H. Fan, Y. Feng, A. R. Shaikh, M. Fang, and Q. Wang, *Energy Conversion and Management* **171**, 1651 (2018)
11. W. Muskała, J. Krzywański, R. Rajczyk, M. Cecerko, B. Kierzkowski, W. Nowak, and W. Gajewski, *Rynek Energii* **87**, 97 (2010)
12. W. Muskała, J. Krzywański, R. Sekret, and W. Nowak, *Chemical and Process Engineering - Inżynieria Chemiczna i Procesowa* **29**, 473 (2008)
13. W. Muskała, J. Krzywański, T. Czakiert, and W. Nowak, *Rynek Energii* **172** (2011)
14. K. K. Win, W. Nowak, H. Matsuda, M. Hasatani, Z. Bis, J. Krzywanski, and W. Gajewski, *JOURNAL OF CHEMICAL ENGINEERING OF JAPAN* **28**, 535 (1995)
15. J. Krzywanski, *Entropy* **21**, 919 (2019)
16. J. Krzywański, M. Szyc, W. Nowak, and Z. Kolenda, *Technical Sciences / University of Warmia and Mazury in Olsztyn* **nr 19(4)**, (2016)
17. Q. Wang, X. Gao, J. Y. Xu, A. S. Maiga, and G. M. Chen, *International Journal of Refrigeration* **35**, 694 (2012)
18. C.-H. Chen, G. Schmid, C.-T. Chan, Y.-C. Chiang, and S.-L. Chen, *Applied Thermal Engineering* **89**, 229 (2015)
19. A. M. Hamed, *Renewable Energy* **30**, 1913 (2005)
20. Z. Rogala, P. Kolasiński, and Z. Gnutek, *Applied Thermal Engineering* **127**, 950 (2017)
21. M. Z. I. Khan, K. C. A. Alam, B. B. Saha, A. Akisawa, and T. Kashiwagi, *Applied Thermal Engineering* **27**, 1677 (2007)
22. M. Z. I. Khan, K. C. A. Alam, B. B. Saha, Y. Hamamoto, A. Akisawa, and T. Kashiwagi, *International Journal of Thermal Sciences* **45**, 511 (2006)

* Corresponding author: j.krzywanski@ujd.edu.pl